



A DIVISION OF GETZ FIRE EQUIPMENT

**Getz Equipment Innovators
Part No.: 3G59558
Water Reclaim Tank**

Revised 11-8-2017



2320 Lakecrest Drive, Pekin IL 61554
PH. (888) 747-4389 • Fax (309) 495-0625
Website: www.getzequipment.com

LIMITED WARRANTY

Getz Equipment Innovators warrants its products, and component parts of any product manufactured by Getz Equipment Innovators, to be free from defects in material and workmanship for a period of twelve (12) months from the date of purchase. During the warranty period, any such defects will be repaired or the defective parts replaced **(at Getz Equipment Innovators' option)**. The warranty does not cover defects resulting from modification, alteration, misuse, exposure to corrosive conditions, extremely high temperatures, improper installation or maintenance. Warranties on component items not manufactured by Getz Equipment Innovators are provided by others whose warranty, evaluation and judgment will be final.

All implied warranties, including, but not limited to, warranties of fitness for purpose and merchantability, are limited to the time periods as stated above. In no event shall Getz Equipment Innovators be liable to incidental or consequential damages. Some states do not allow limitations on how long an implied warranty lasts or the exclusions or limitation of incidental or consequential damages, so that the above limitations or exclusions may not apply to you. Getz Equipment Innovators neither assumes nor authorizes any representative or other person to assume for it any obligation or liability other than as expressly set forth herein.

Mobile Service Vehicles:

The warranty does not cover:

- Defects in the chassis and or power unit
- Defects in separately manufactured products not produced by Getz Equipment Innovators
- Deterioration due to normal wear, tear, and exposure
- Repairs made necessary by negligent use, misuse, abuse, loading the service vehicle beyond its gross vehicle weight limitations, accident, acts of God, or other contingencies beyond the control of Getz Equipment Innovators.
- Repairs deemed necessary by reason of the failure to follow ordinary maintenance procedures.
- Repairs deemed necessary by reason of alterations done without Getz Equipment Innovators' written approval.

Warranty Service:

- All warranty repairs will be performed by Getz Equipment Innovators in Pekin, IL, unless otherwise authorized by Getz Equipment Innovators.

Freight:

- Getz Equipment Innovators will not be liable for shipping or transportation charges to or from customer's location.

This warranty gives you specific legal rights, and you may also have other rights which vary from state to state. To obtain performance to the obligation of the warranty, write to Getz Equipment Innovators, 2320 Lakecrest Drive, Pekin IL 61554, USA for instructions.

**Getz Equipment Innovators
Water Reclaim Tank (3G59558)**

Table of Contents

Page

| | | |
|---|-------|---|
| 1 | | Requirements, Drawing, Parts List |
| 2 | | Mounting and Installation Instructions |
| 3 | | Mounting and Installation Instructions, Continued |
| 4 | | Operating Instructions & Trouble Shooting |

**Getz Equipment Innovators
(3G59558)**


Power Source:

A 120AC or power inverter if used in a mobile application

Safety Requirements:

Safety Glasses

DRAWING 1

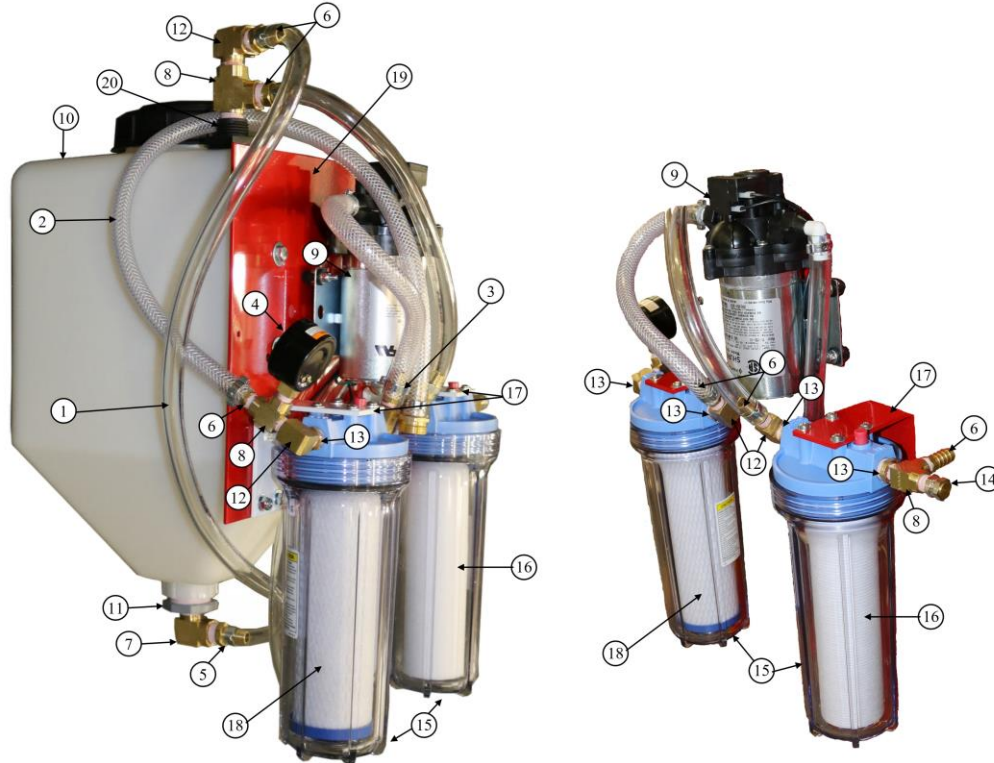

DRAWING 1

| ITEM | PART # | DESCRIPTION | QTY | ITEM | PART # | DESCRIPTION | QTY |
|------|--------|---------------------------|-----|------|---------|-------------------------------|-----|
| 1 | 1G0032 | Tubing ½ I.D. Clear Vinyl | 8 | 11 | 1G0588 | Threaded Bushing CPVC 1 ¼ x ½ | 1 |
| 2 | 1G0033 | Tubing ½ Reinforced Clear | 3.5 | 12 | 1G51624 | Pipe Elb Br ¼ St | 4 |
| 3 | 1G0041 | Clamp 2 – Ear ¾" | 9 | 13 | 1G51683 | Pipe RDCR Br 3/8 x ¼ | 4 |
| 4 | 1G0064 | Gauge Dry 0-160 PSI | 1 | 14 | 1G53061 | Pressure Relief Valve 40PSI | 1 |
| 5 | 1G0075 | Barb Hose ½ MNPT x ½ Hose | 1 | 15 | 1G54023 | Filter Housing | 2 |
| 6 | 1G0076 | Barb Hose ¼ MNPT x ½ Hose | 6 | 16 | 1G54024 | Water Filter Element | 1 |
| 7 | 1G0291 | ½ Brass Elbow M/F | 1 | 17 | 1G54026 | Water Filter Bracket | 2 |
| 8 | 1G0428 | Brass Tee ¼ | 3 | 18 | 1G54097 | Carbon Water Filter Element | 1 |
| 9 | 1G0502 | Pump 120V Water Reclaim | 1 | 19 | 1G54128 | Plate Mnt Filter/Pump Wt | 1 |
| 10 | 1G0505 | Tank 5 Gal Water Reclaim | 1 | 20 | 1G54144 | Plastic Bulkhead Fitting ¼ | 1 |

**Getz Equipment Innovators
(3G59558)**

Mounting/Installation Instructions:

1. Remove zip ties to free up the hoses and wiring.



2. Mount the red plate roughly 15 inches down from the bottom of the top plate on the stand, using supplied 5/16 head SDS screws. You will need to remove the filter housing to access the bottom mounting holes.



3. Connect the discharge hose of the tester to the hose barb on the right side of the water filter. You will need to cut the hose to fit length.




**Getz Equipment Innovators
(3G59558)**

4. Connect the hose with the brass garden hose fitting to the water inlet of the tester



5. Mount switch plate to the top plate of the hydro tester.

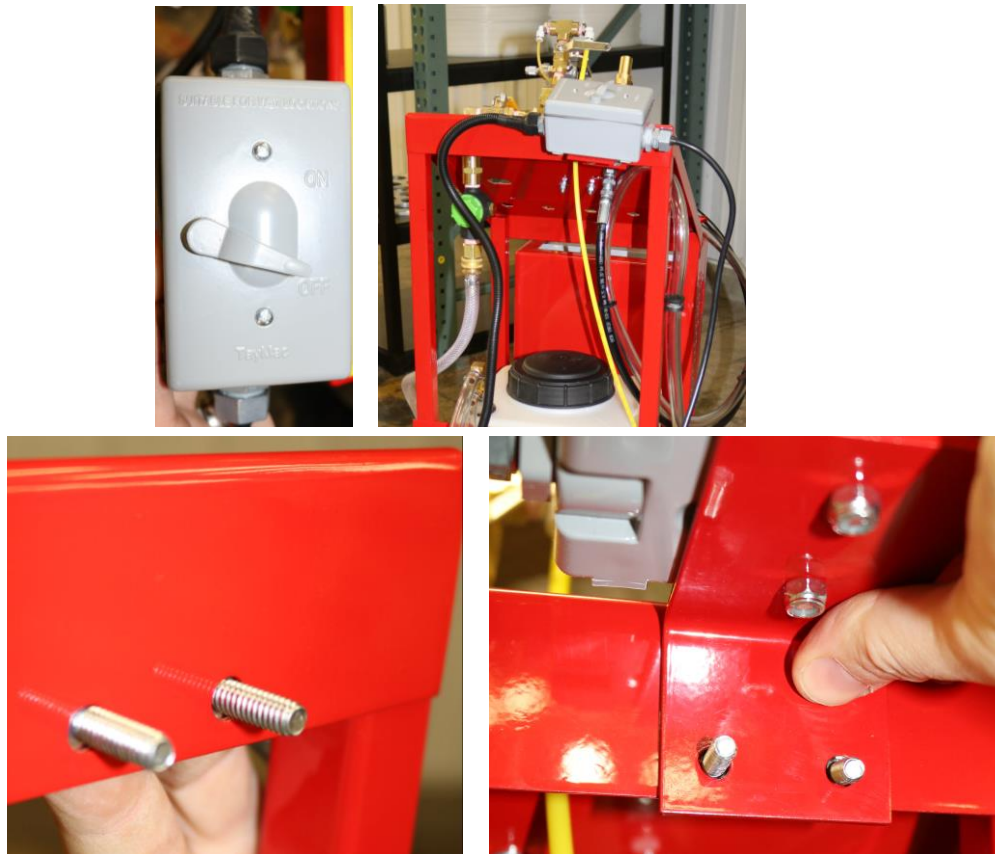

6. Plug the pump into a 120V receptacle. Make sure the switch for the pump is in the off position.

**Getz Equipment Innovators
(3G59558)**

Operating Instructions:

1. Fill water tank to the 5-gallon mark
2. To begin filling the cylinder, open all the valves on the tester and turn the switch on to start the water pump
3. Once the cylinder is full, keep the water pump on and follow the operating procedures for the hydrostatic tester. Verify by checking the water level in the filter housing (Item 16).

Maintenance Instructions:

1. Check the water filter every week or approximately every 100 cylinders tested depending on water quality. You will need to change the standard filter (Item 16) every 6 months and the carbon filter (Item 18) every 12 months.
2. Do not leave or operate water tank in temperatures below 32° F

Trouble Shooting

Issue

Solution

The pump is not operating

Verify the pump is plugged into a 120V outlet.

Make sure switch for pump is in the “on” position.

Check to see if the valve on the tester is closed, creating back pressure on the pump, shutting it off.

No water flow to the cylinder

Check to see if the water tank is empty.

Check to see if the filters on the water tank are clogged.